


# INSTALLATION DIAGRAM BLUE BUS TDS / BLUE BUS TDS RX

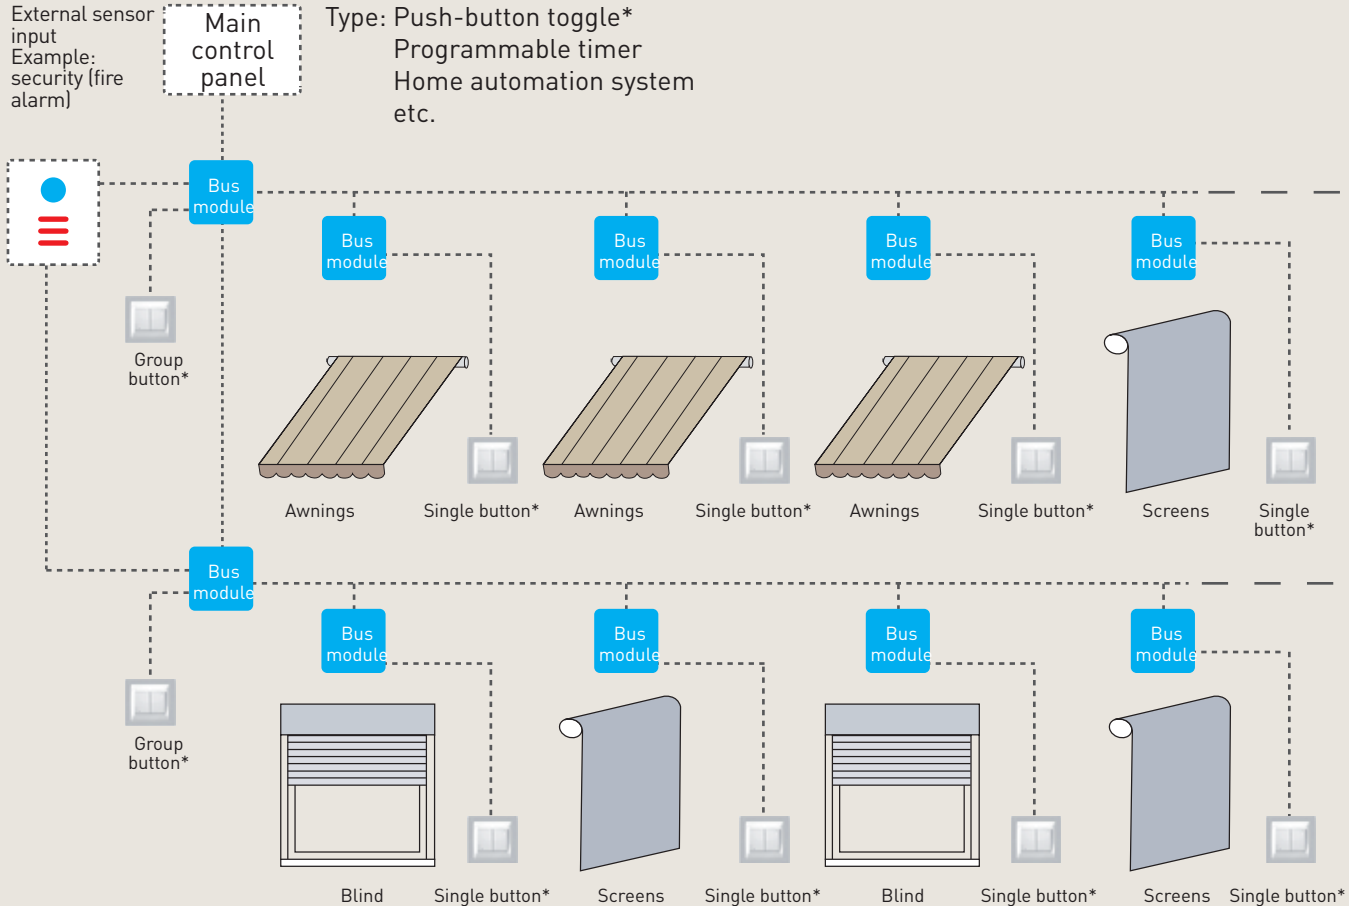

\*It is preferable to use a switch type unstable.